


SYMBOLS / ABBREVIATIONS

- A.P. ACCESS PANEL
- C.A. CONTRIBUTION AIR
- F.A. FRESH AIR
- E.A.D. EXHAUST AIR DUCT
- R.A.D. RETURN AIR DUCT
- S.A.D. SUPPLY AIR DUCT
- M.D. MANUAL DAMPER W/OPOSED BLADES & LOCKING DEVICE.
- V.D. BUTTERFLY DAMPER W/LOCKING DEVICE.
- H.W. HOT WATER
- CHWS CHILLED WATER SUPPLY.
- CHWR CHILLED WATER RETURN.
- D DRAIN
- F.C. FLEXIBLE CONNECTION
- G.S.M. GALVANIZED SHEET METAL
- G.V. GATE VALVE
- T.C.V. TEMPERATURE CONTROL VALVE.
- M.A.V. MANUAL AIR VENT
- LOCATE IN TEMPERATURE CONTROL PANEL.
- BY CONTROL CONTRACTOR.
- BY ELECTRICAL CONTRACTOR.
- BALANCING VALVE
- CHECK VALVE
- F.D. FIRE DAMPER

TEMPERATURE AIR UNIT SCHEDULE

SYMBOL	CM'SIDE
①	40
②	50
③	60
④	65

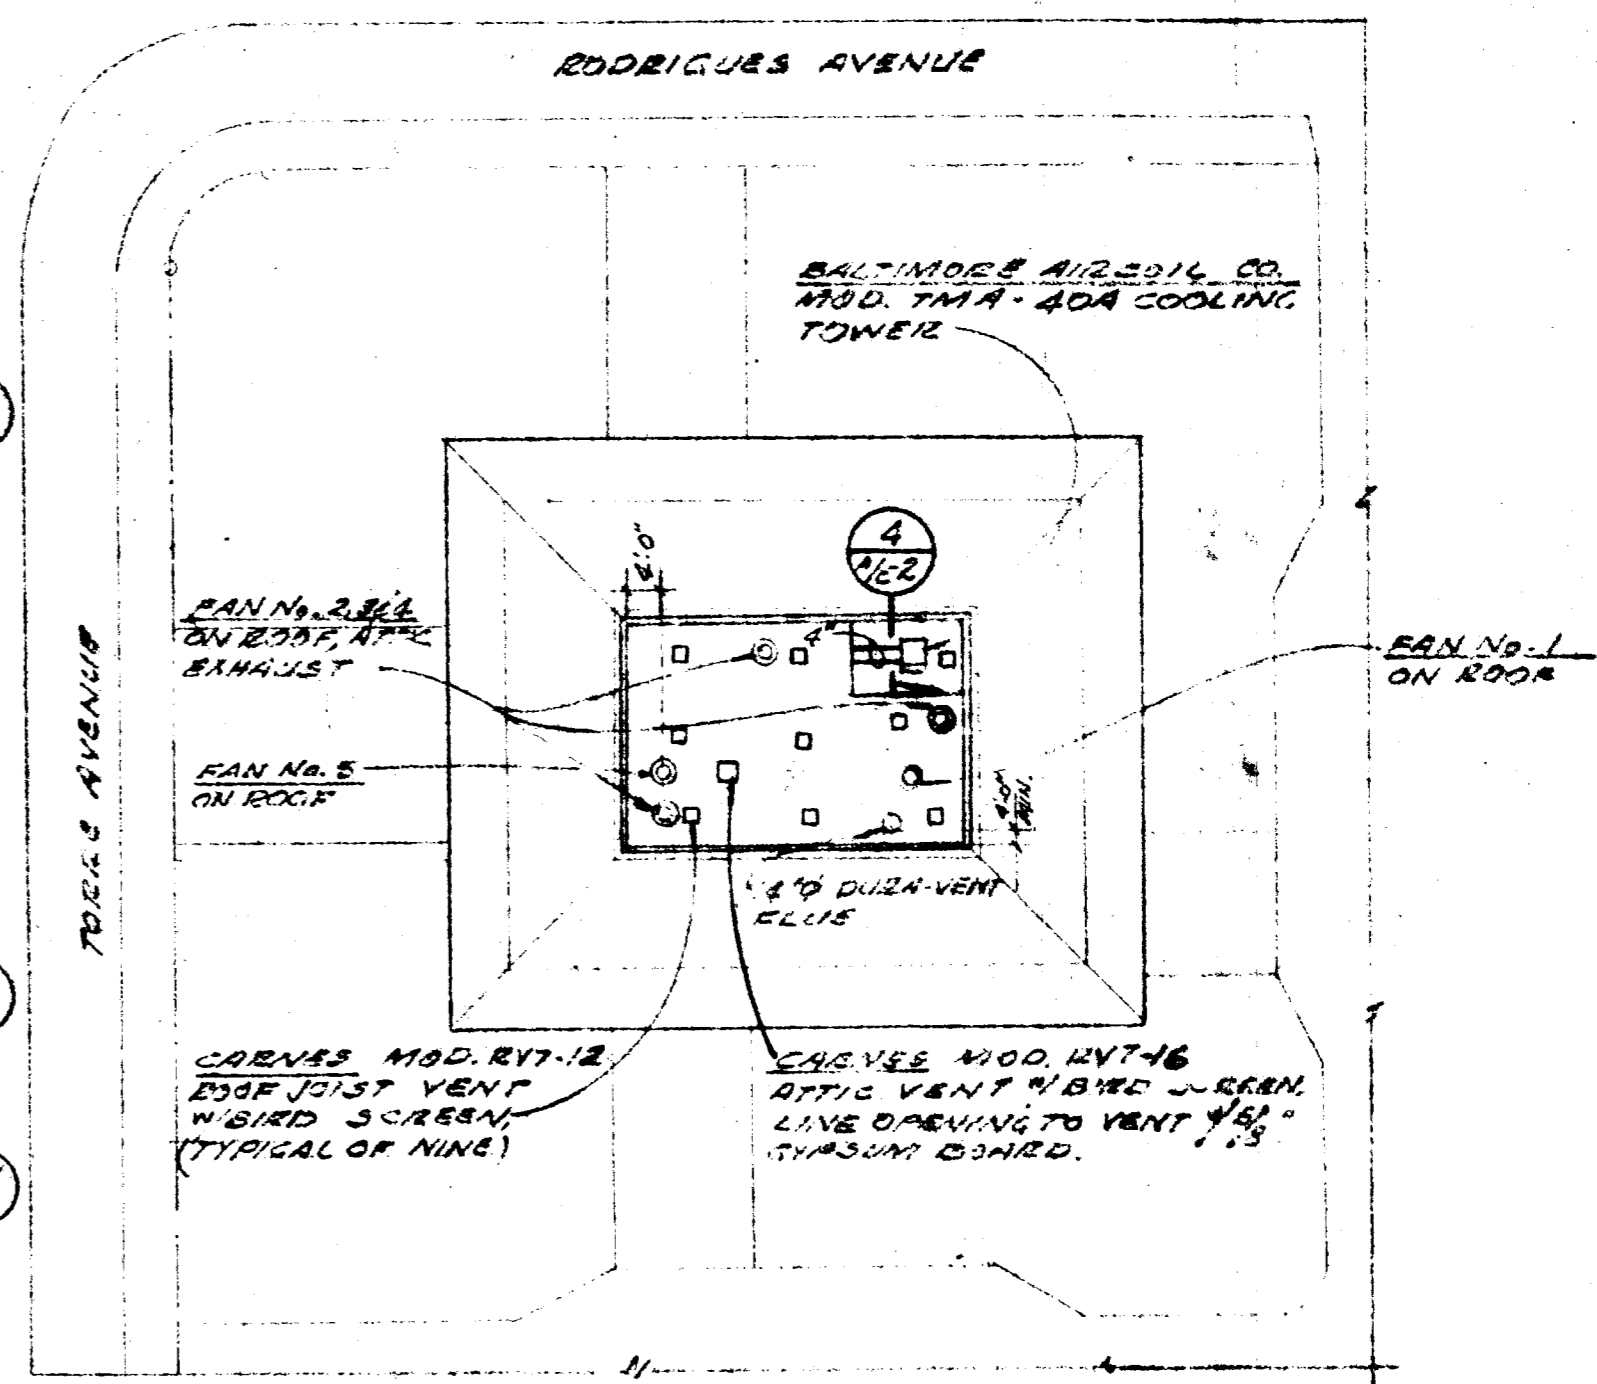

FIRST FLOOR PLAN
SCALE: 1/8" = 1'-0"




PARTIAL PLOT PLAN AND ROOF PLAN
SCALE: 1/4" = 40'-0"

CUPERINO CITY HALL
 S.E. CORNER OF RODRIGUES & TELLER, CUPERINO, CALIFORNIA


AIR CONDITIONING FIRST FLOOR PLAN,
 PARTIAL PLOT PLAN AND ROOF PLAN

DRAWN: G.L.M.
 ENGINEER: J.M.
 DATE: 10-22-55
 WILFRED E. BLESSING A.S.A.
 ARCHITECT & LANDSCAPE ARCHITECT
 1500 THE ALABAMA
 SAN JOSE, CALIFORNIA 95126







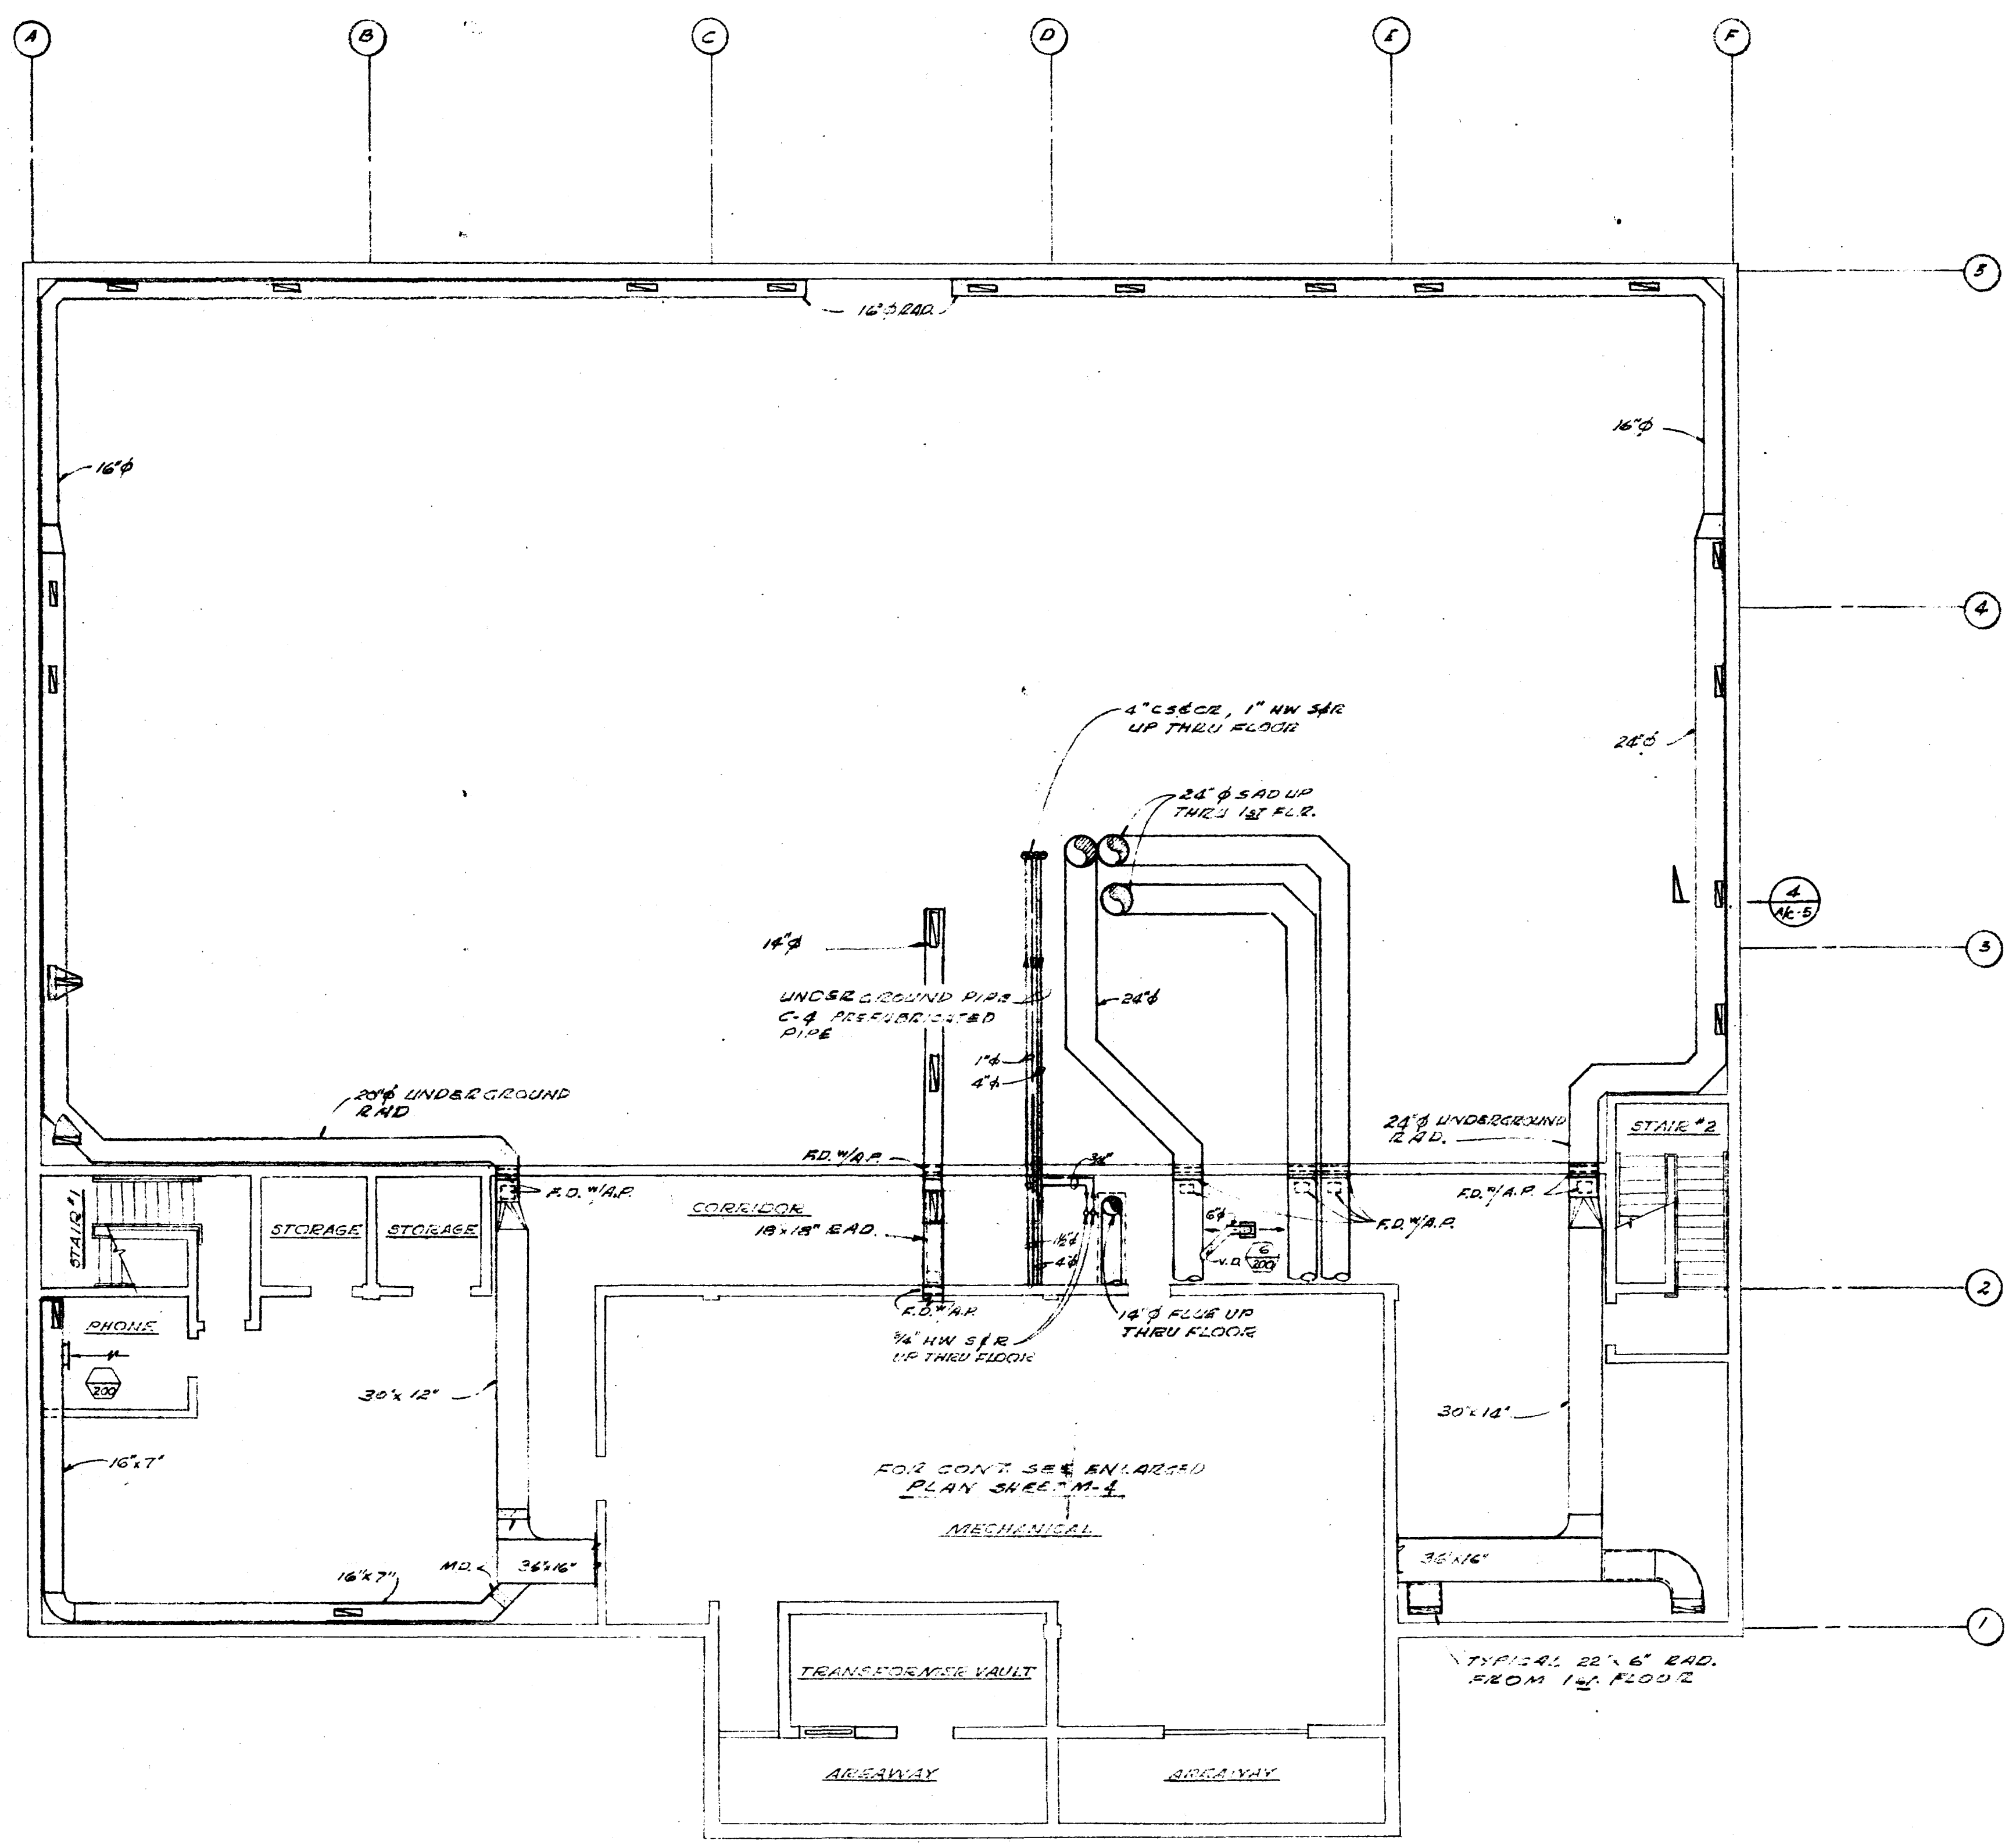


BASEMENT FLOOR PLAN
ALTERNATE #1
 SCALE: 1/4"=1'-0"




DRAWN: C.W.M. CHECKED: C.W.M. DATE: 02/26/58	WILFRED E. BLESSING A.I.A. ARCHITECT & LANDSCAPE ARCHITECT 1004 THE ALAMEDA SAN JOSE, CALIFORNIA 95126	CUPERTINO CITY HALL S.E. CORNER OF RODRIGUES & TORRE, CUPERTINO, CALIFORNIA AIR CONDITIONING BASEMENT FLOOR PLAN + DELEVINE ALTERNATE #1	PROJECT NO. 5801 DATE: 02/26/58
--	--	--	------------------------------------

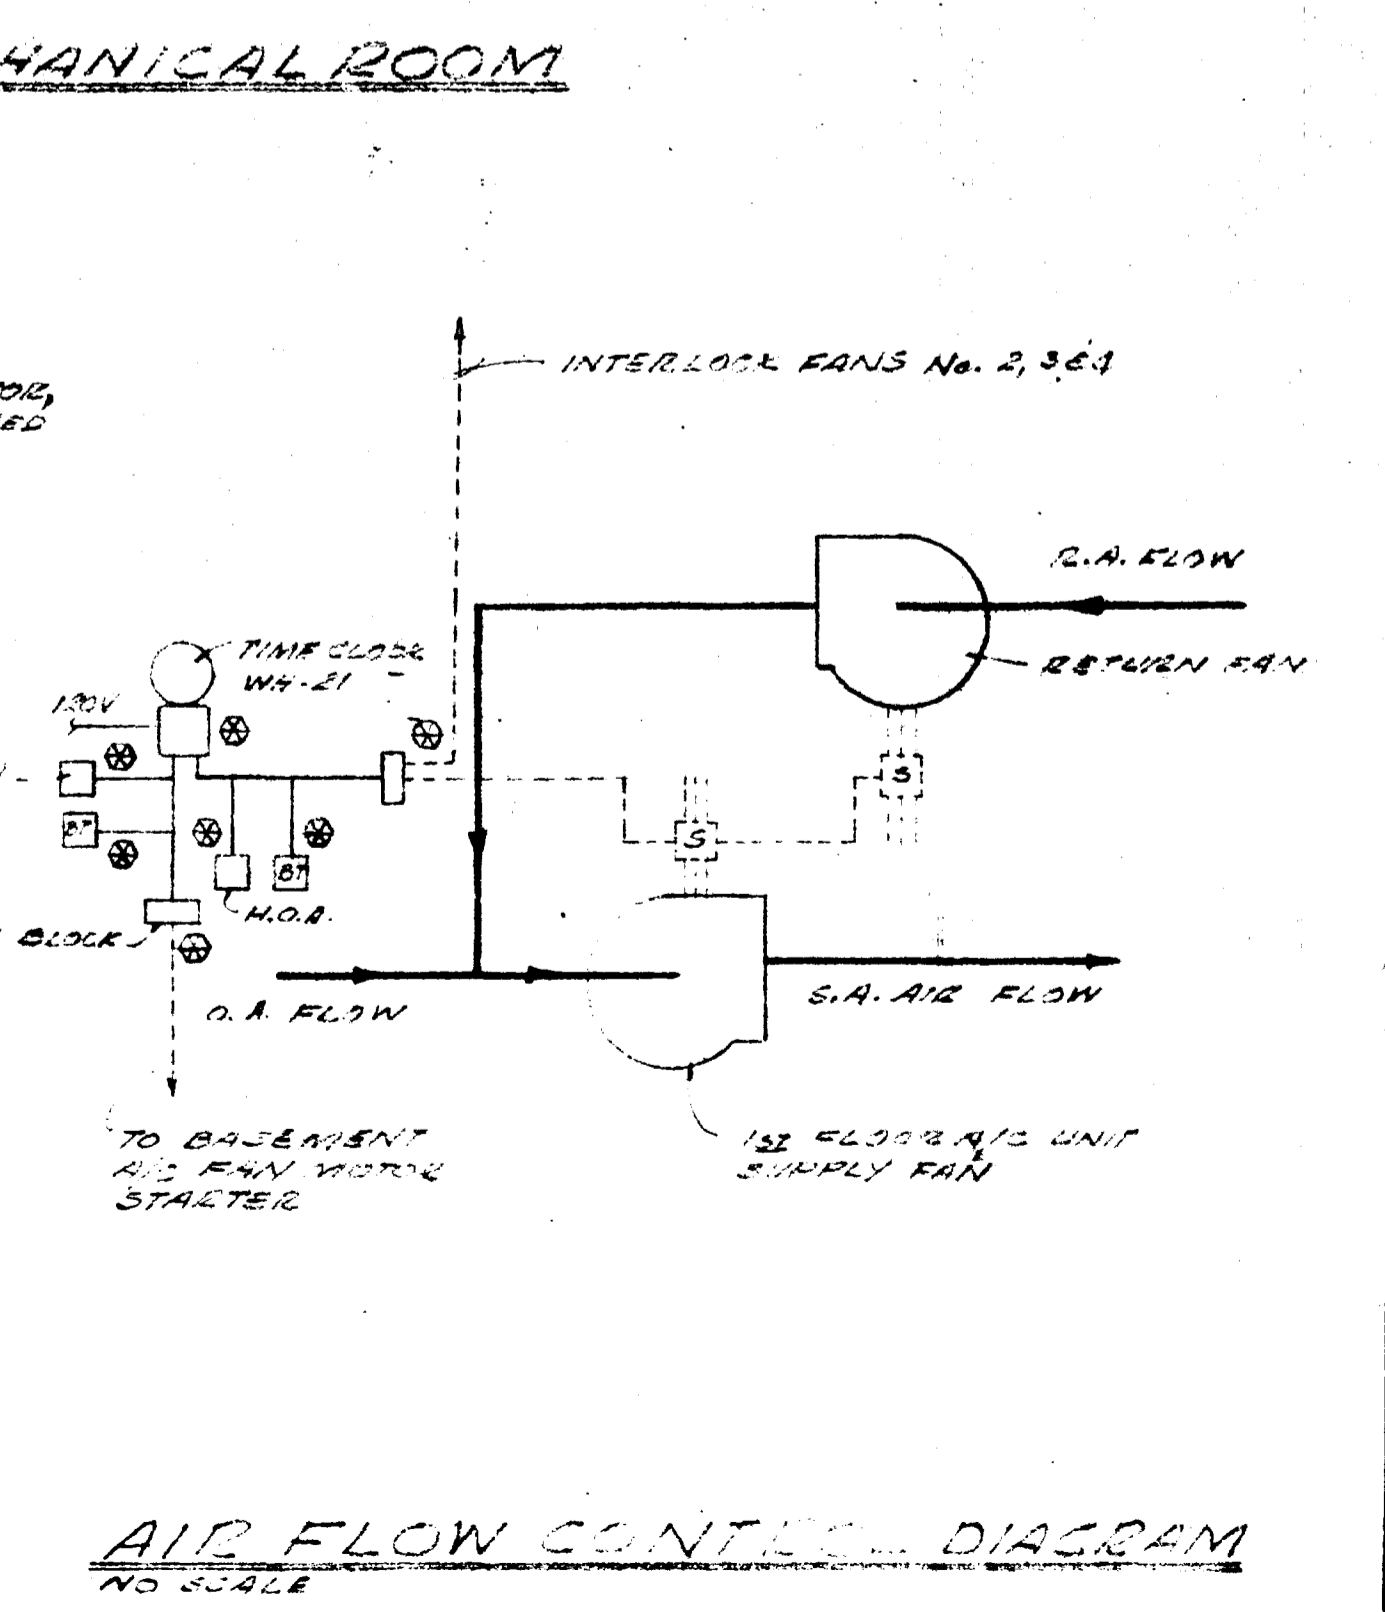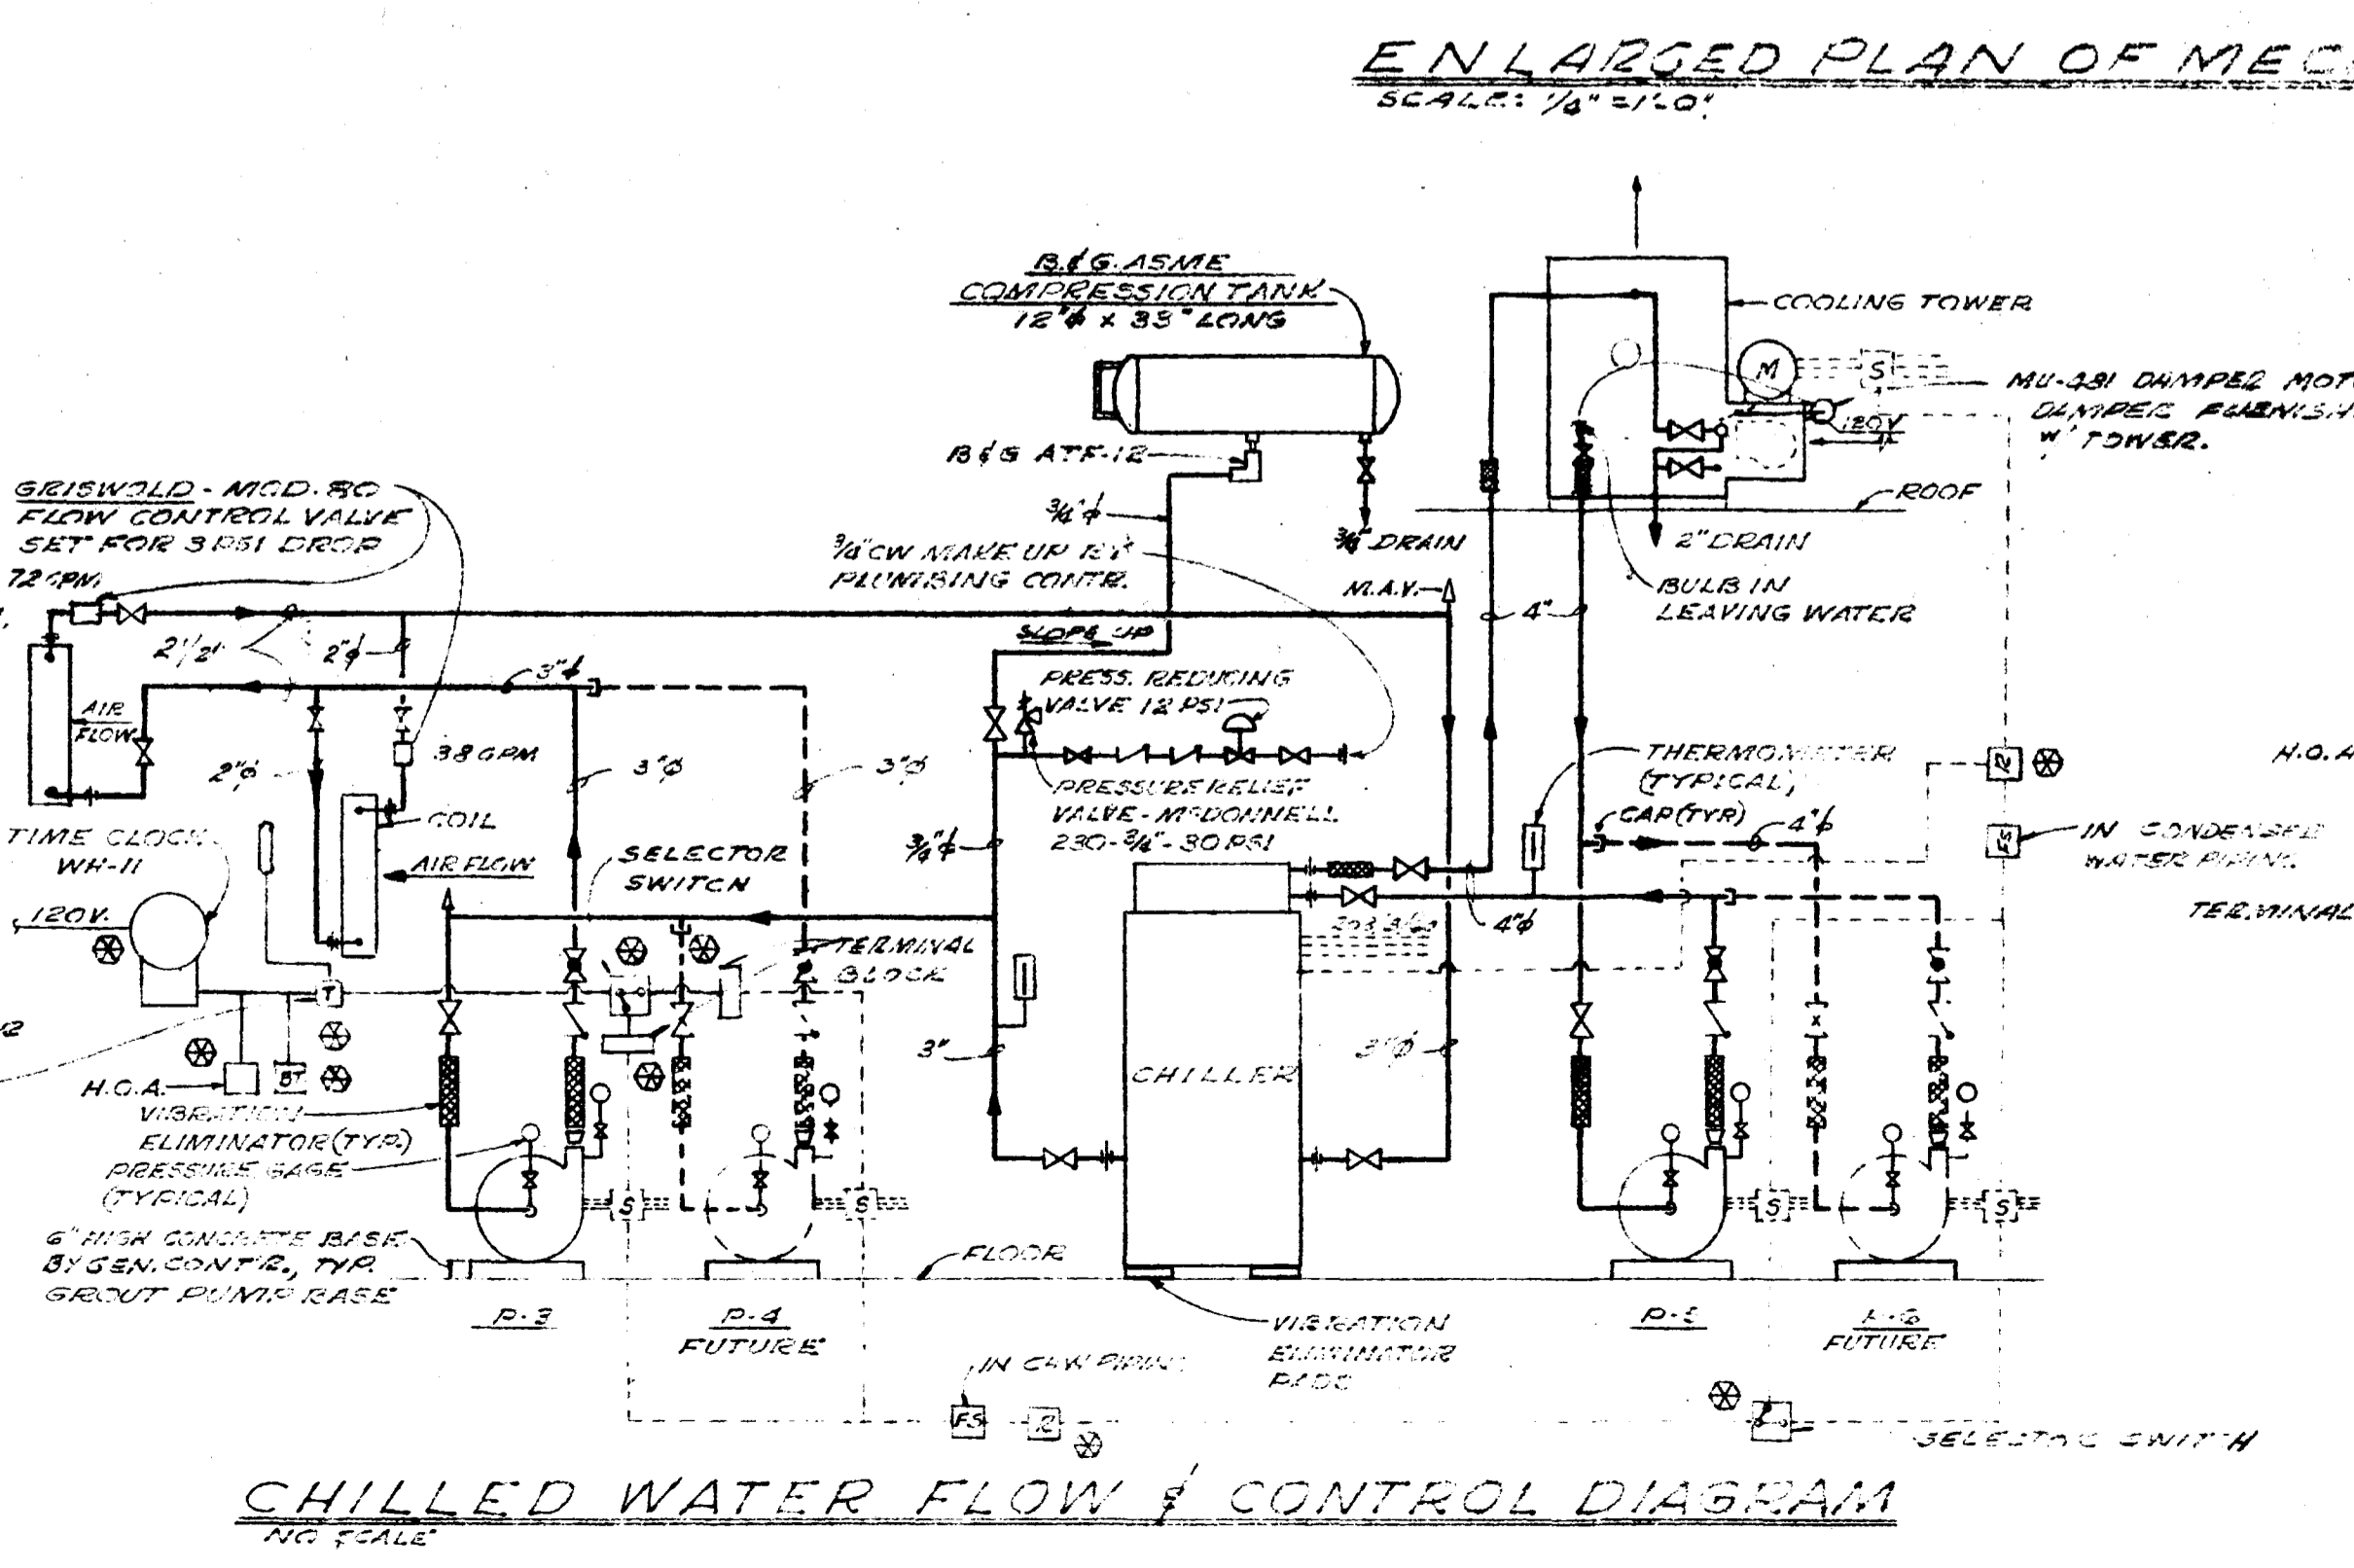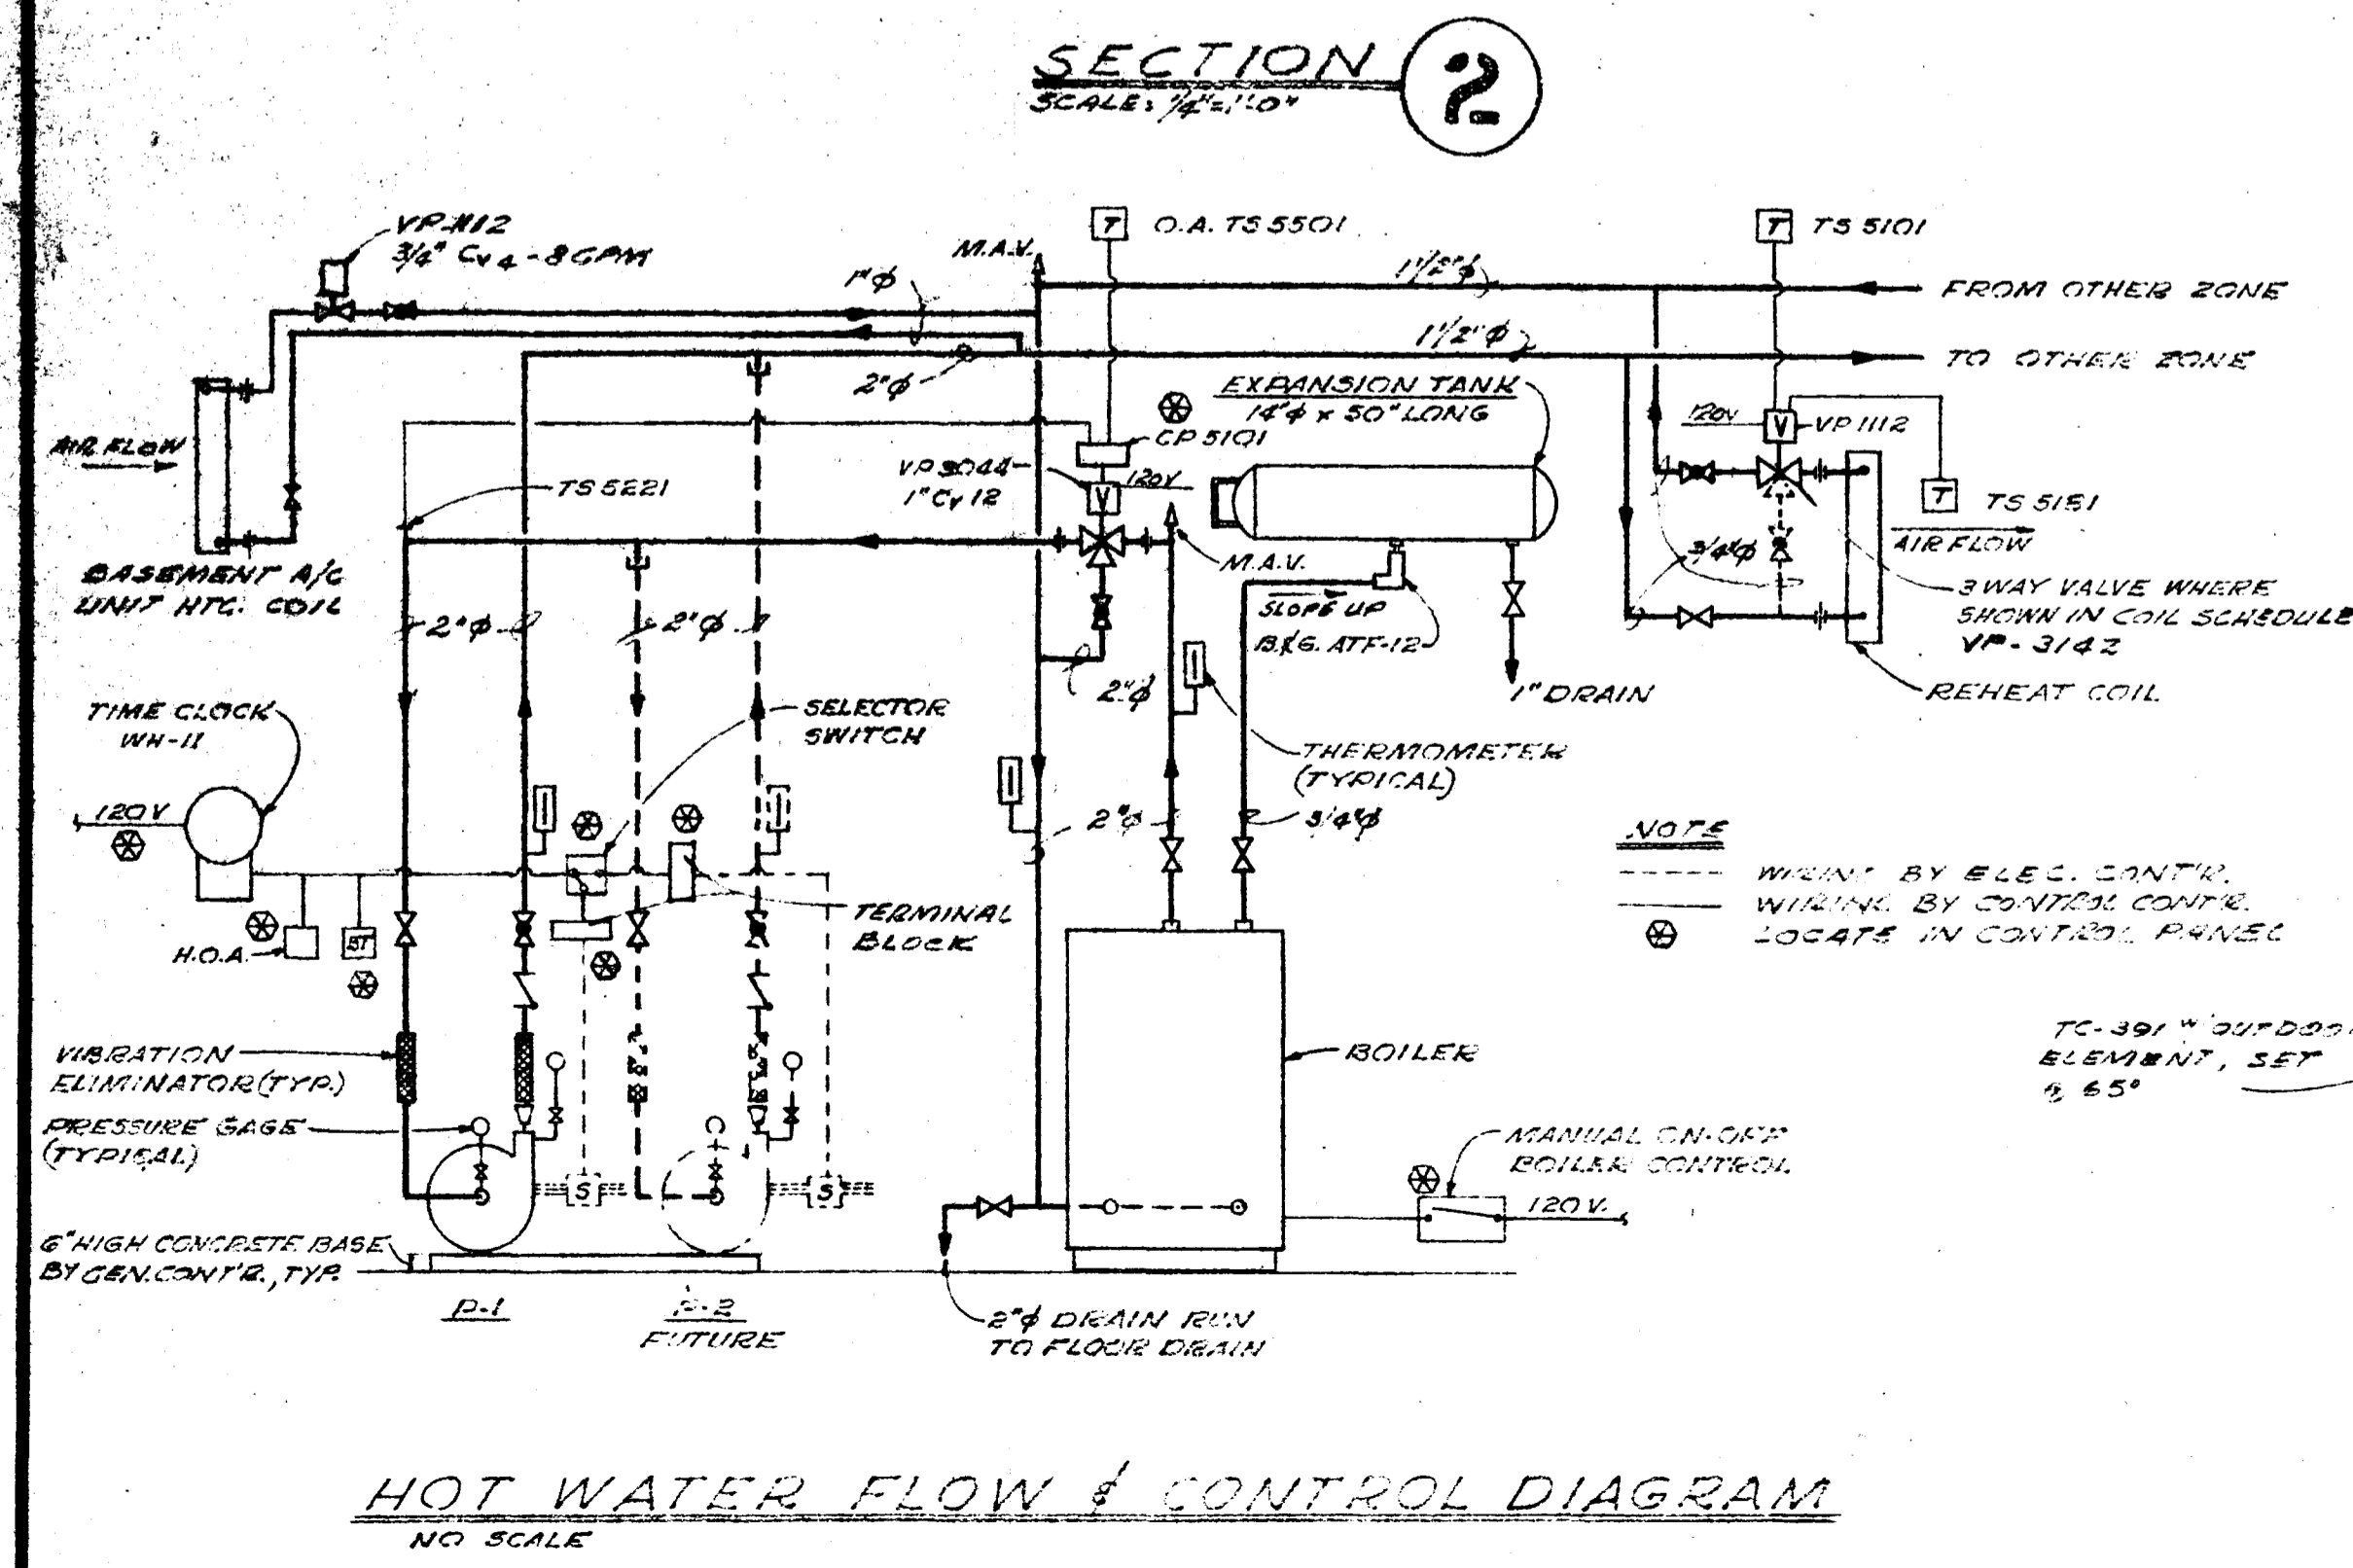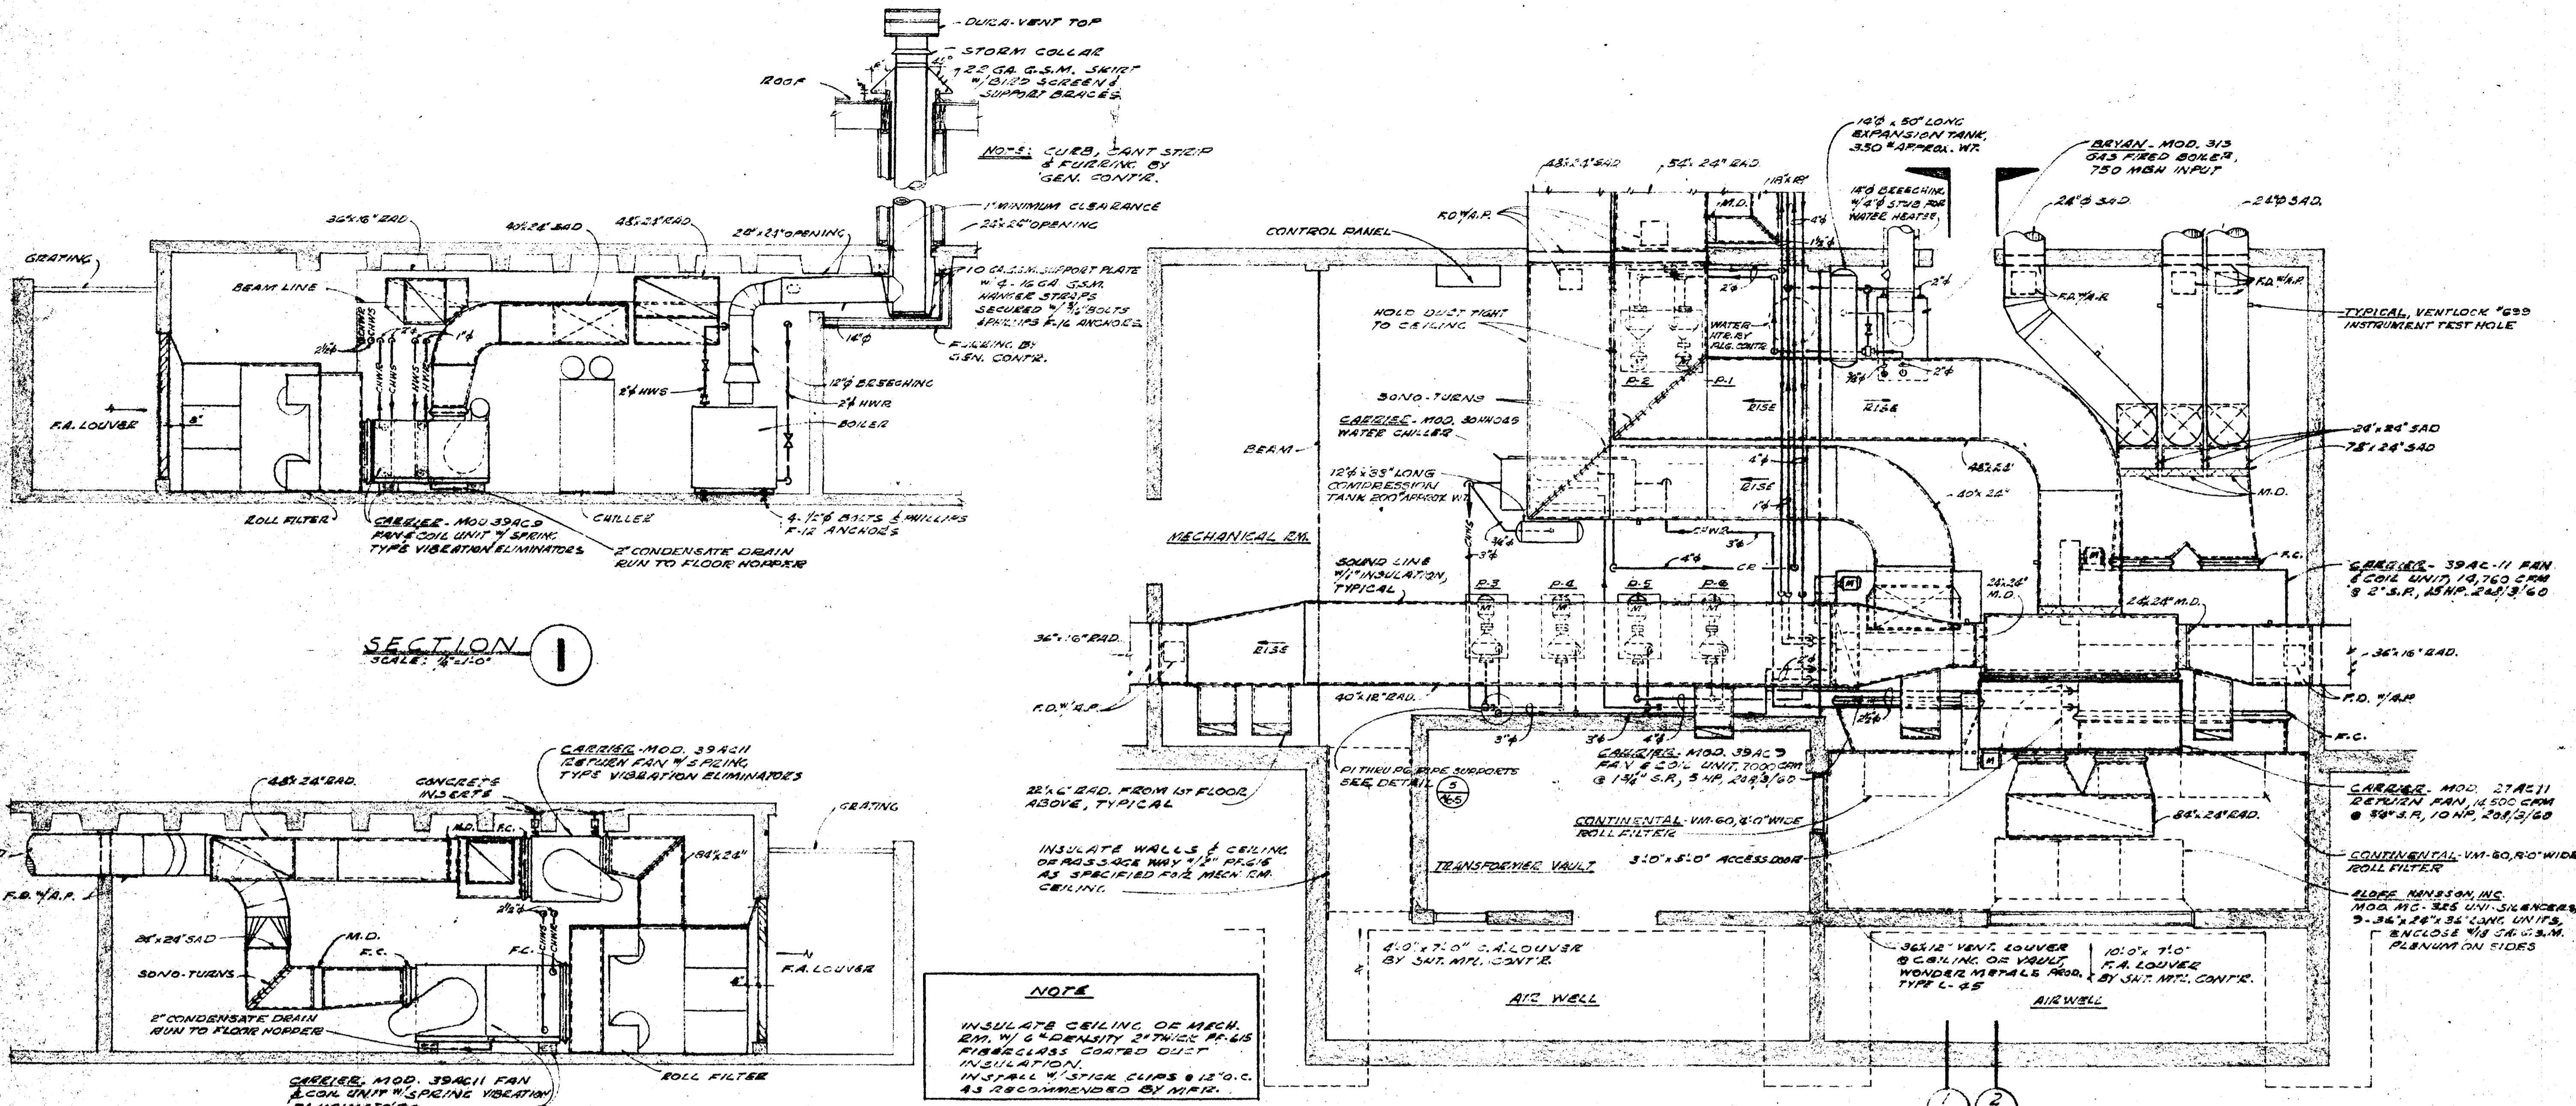


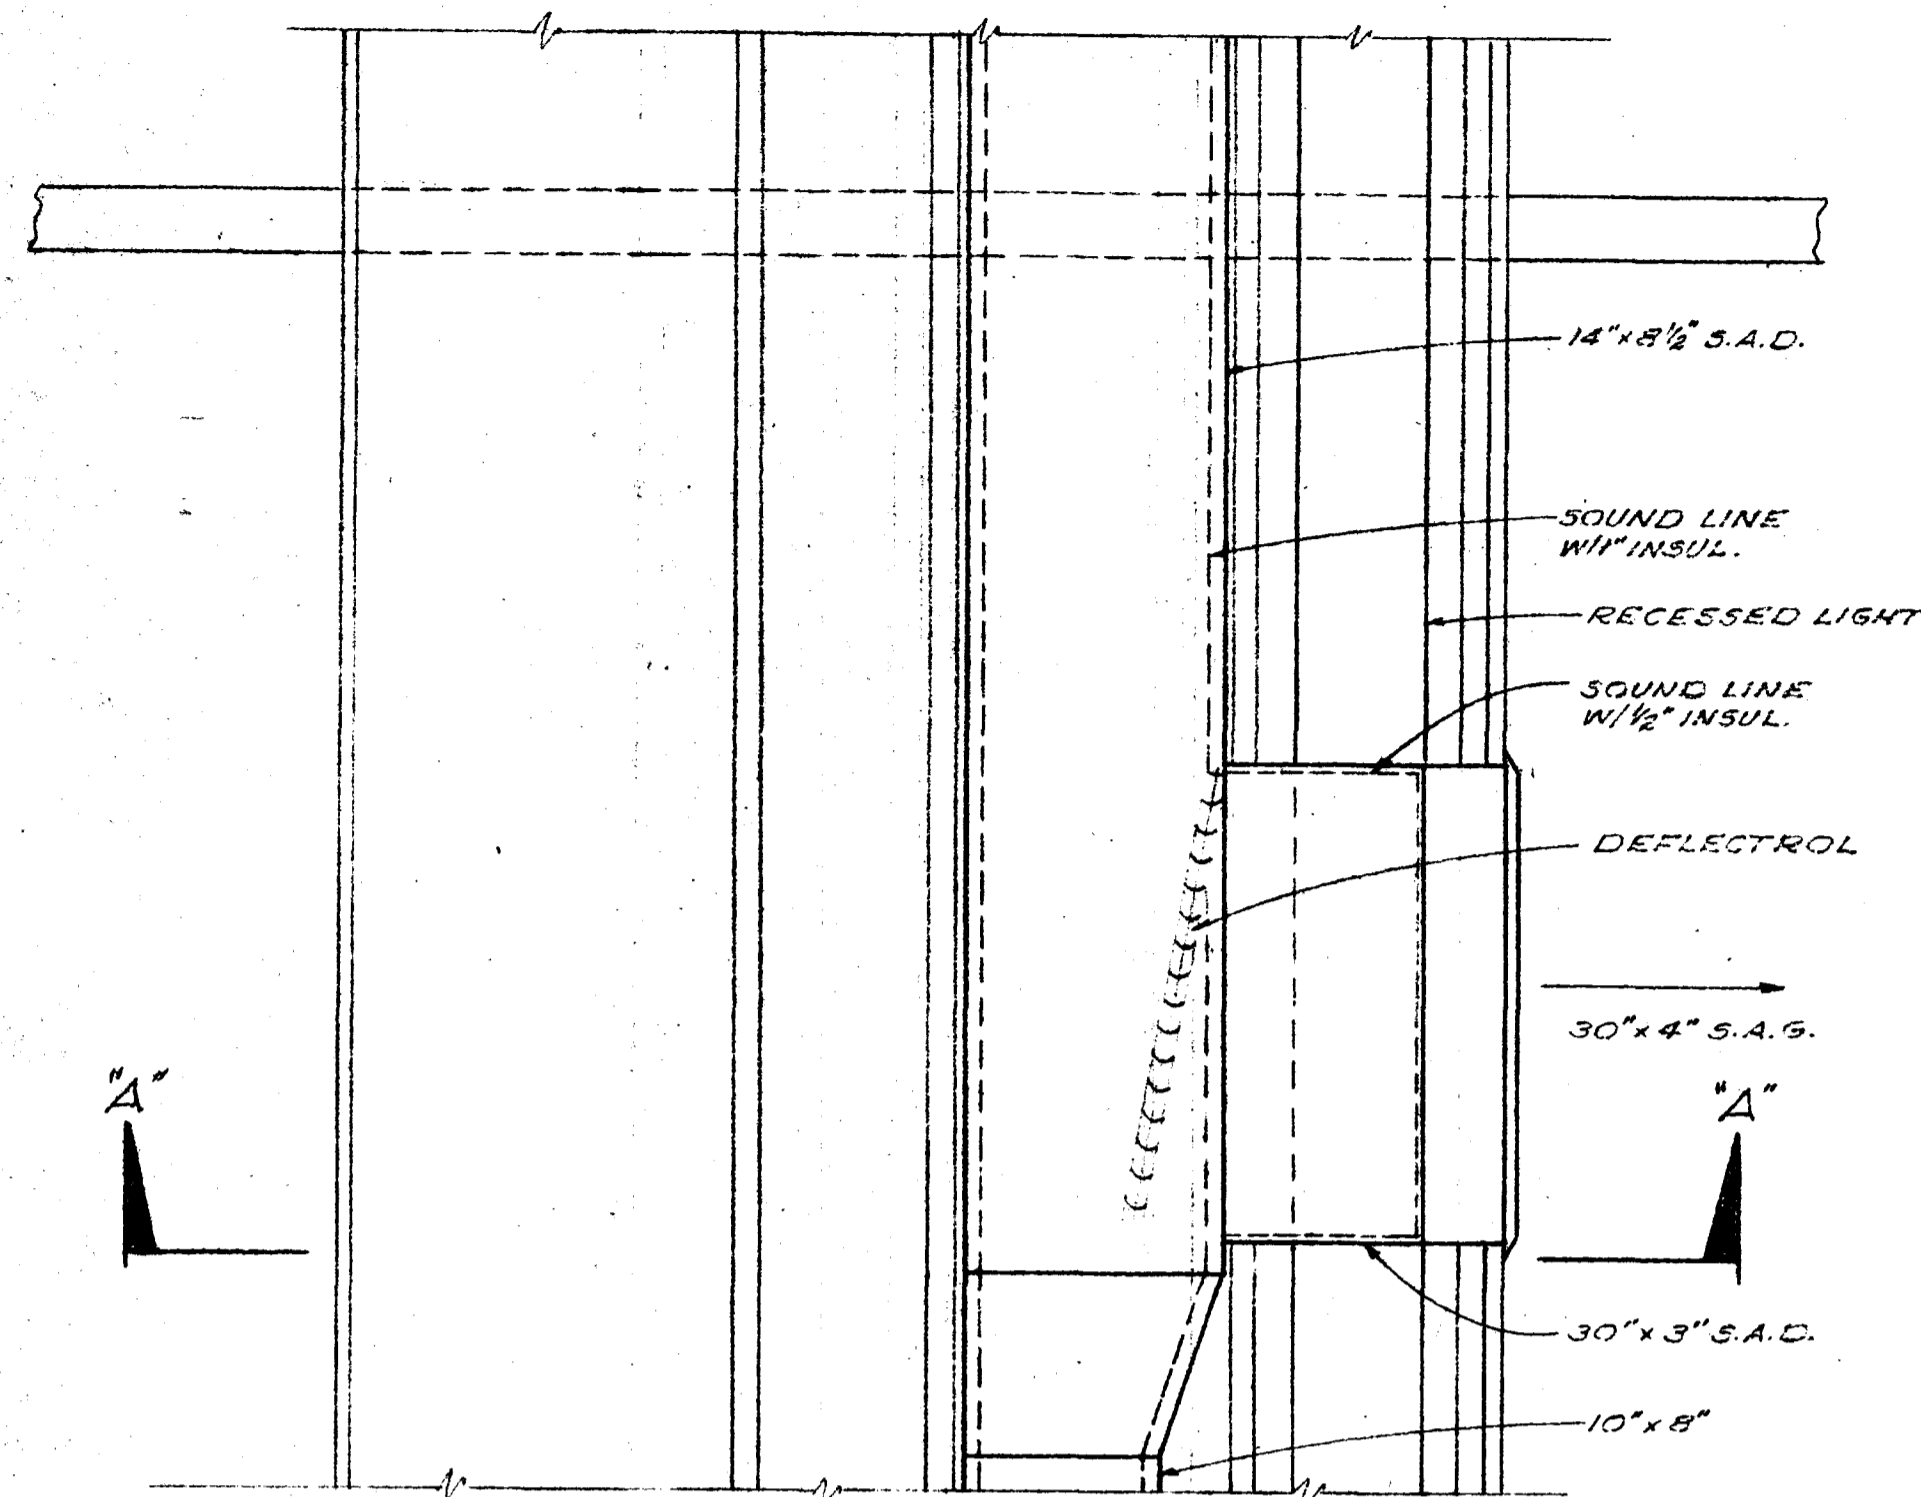

1 PARTIAL PLAN DUCT & LIGHT ENCLOSURE
SCALE: 1/2" = 1'-0"

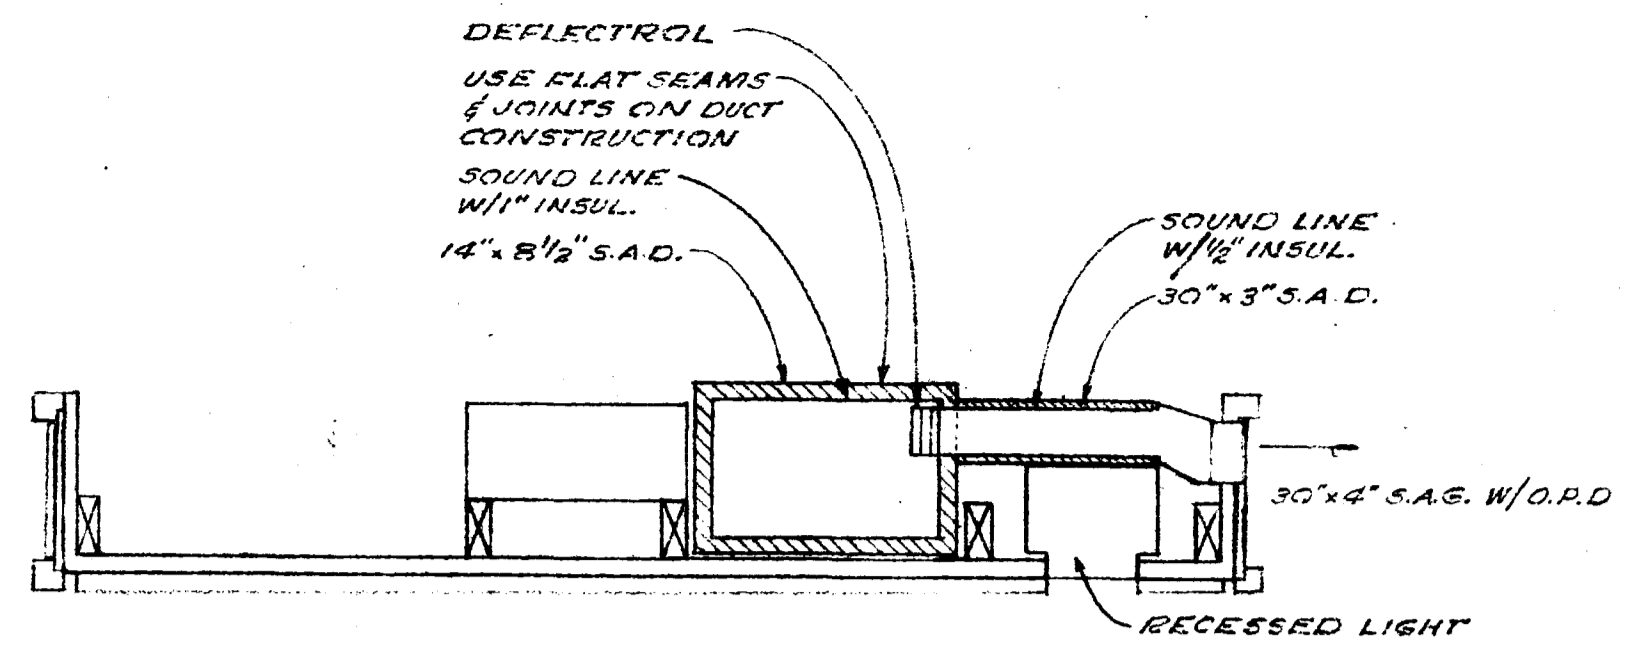

SECTION A-A
SCALE: 1/2" = 1'-0"

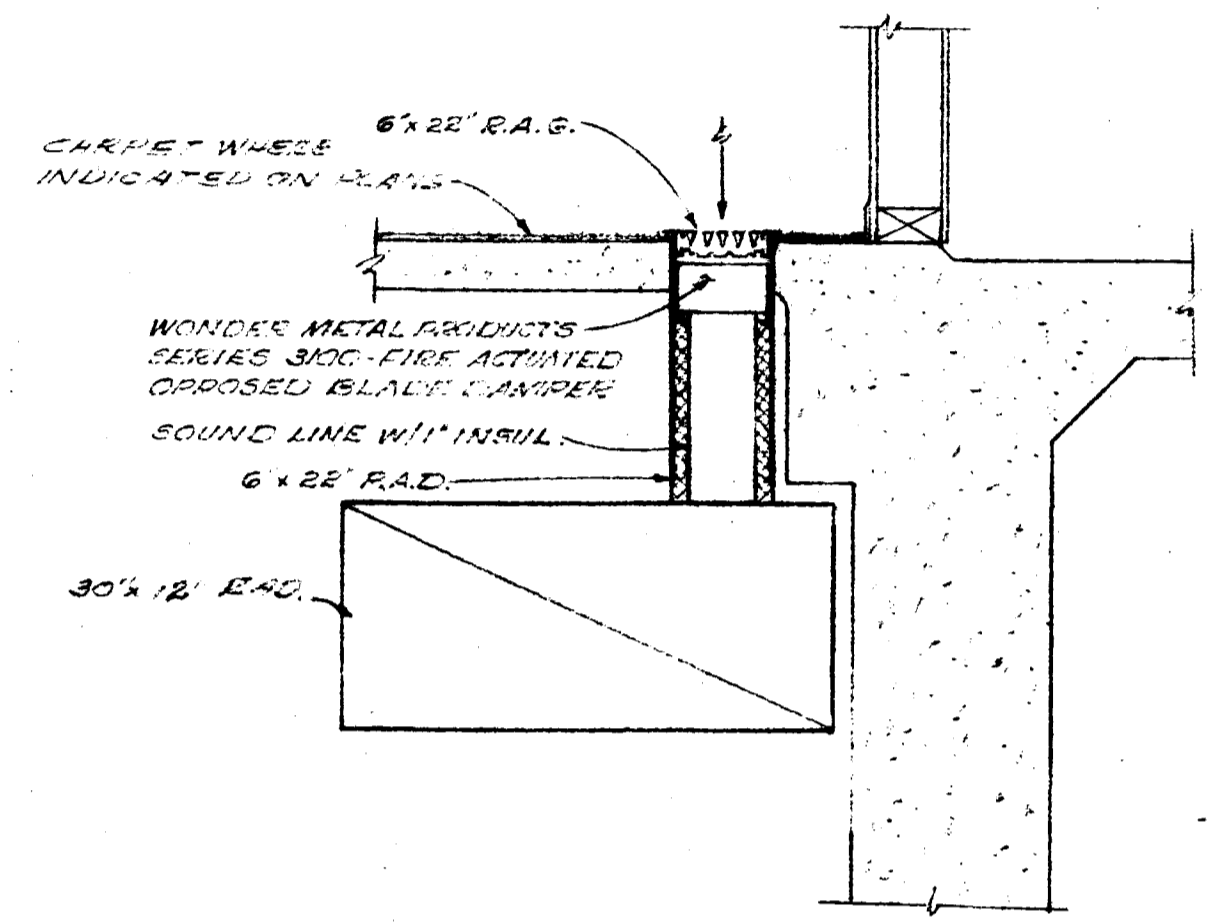

2 SECTION
SCALE: 1/2" = 1'-0"

FAN SCHEDULE

MARK	MFR	MODEL NO.	ARRS.	C.F.M.	S.P.	H.P.	ELECTRICAL	REMARKS
1	CARNES	DIE-12A	-	700	1/2	1/2	120/160 T.C.	ELEC. EXHAUST
2	"	BES-22A	-	2,330	1/2	1/2	"	"
3	"	"	-	"	1/2	"	"	"
4	"	"	-	"	1/2	"	"	"
5	"	DIE-10B	2 SPD.	800	1/2	1/8	"	MECH. " "

PUMP SCHEDULE

MARK	MFR	MODEL NO.	CPM	HEAD	HP	POWER	REMARKS
P-1	BELL & GOSSETT	1510 TYPE B 1 1/2" A/B	20.3	34.5	1	208/3/60	HTG. PUMP
P-2	"	"	"	"	"	"	FUTURE STANDBY
P-3	"	1510 TYPE B 2 1/2" A	11.4	37.6	3	"	CHW PUMP
P-4	"	"	"	"	"	"	FUTURE STANDBY
P-5	"	1510 TYPE B 2 1/2" A	12.5	41.55	3	"	C PUMP
P-6	"	"	"	"	"	"	FUTURE STANDBY


NOTE: ALL STANDBY PUMPS SHALL BE PURCHASED AND INSTALLED BY OWNER IN FUTURE.

COIL SCHEDULE


ZONE	MARK	MFR	TYPE	FIN	CIRC	TF	TL	ROWS	CFM	EAT	LAT	SPM	EWT	LWT	TOTAL BTU	FRICTION	PROP	T.C.V.	Cy	REMARKS
1	1	AMER. BLWR.	BW	R	2	10	42	1	3500	60	80	9	200	150	75,000	0.14	2.0	1/2"	1.3	REHEAT
2	2	"	"	"	1	10	15	1	1120	60	80	1.2	200	160	24,200	0.11	1.57	1/2"	3.3	"
3	3	"	"	"	1	10	21	1	1600	60	80	1.45	200	150	36,700	0.12	2.27	1/2"	0.64	"
4	4	"	"	"	1	8	12	1	740	60	80	1.1	200	170	16,000	0.12	0.90	1/2"	0.64	"
5	5	"	"	"	1	10	15	1	1080	60	80	1.17	200	160	23,600	0.11	1.57	1/2"	3.3	"
6	6	"	"	"	1	10	21	1	1740	60	80	1.67	200	180	35,300	0.11	3.24	1/2"	1.4	"
7	7	"	"	"	2	10	36	1	2220	60	80	3.05	200	160	61,000	0.12	1.63	1/2"	1.4	"
8	8	"	"	"	1	10	21	1	1480	60	80	1.69	200	160	33,700	0.11	3.15	1/2"	3.3	"
9	9	"	"	"	1	8	12	1	700	60	80	1.0	200	170	15,100	0.11	0.80	1/2"	0.64	"

NOTE: COILS No. 2, 5 & 8 TO HAVE 3-WAY T.C. VALVES


NOTE: COILS No. 2, 5 & 8 TO HAVE 3-WAY T.C. VALVES

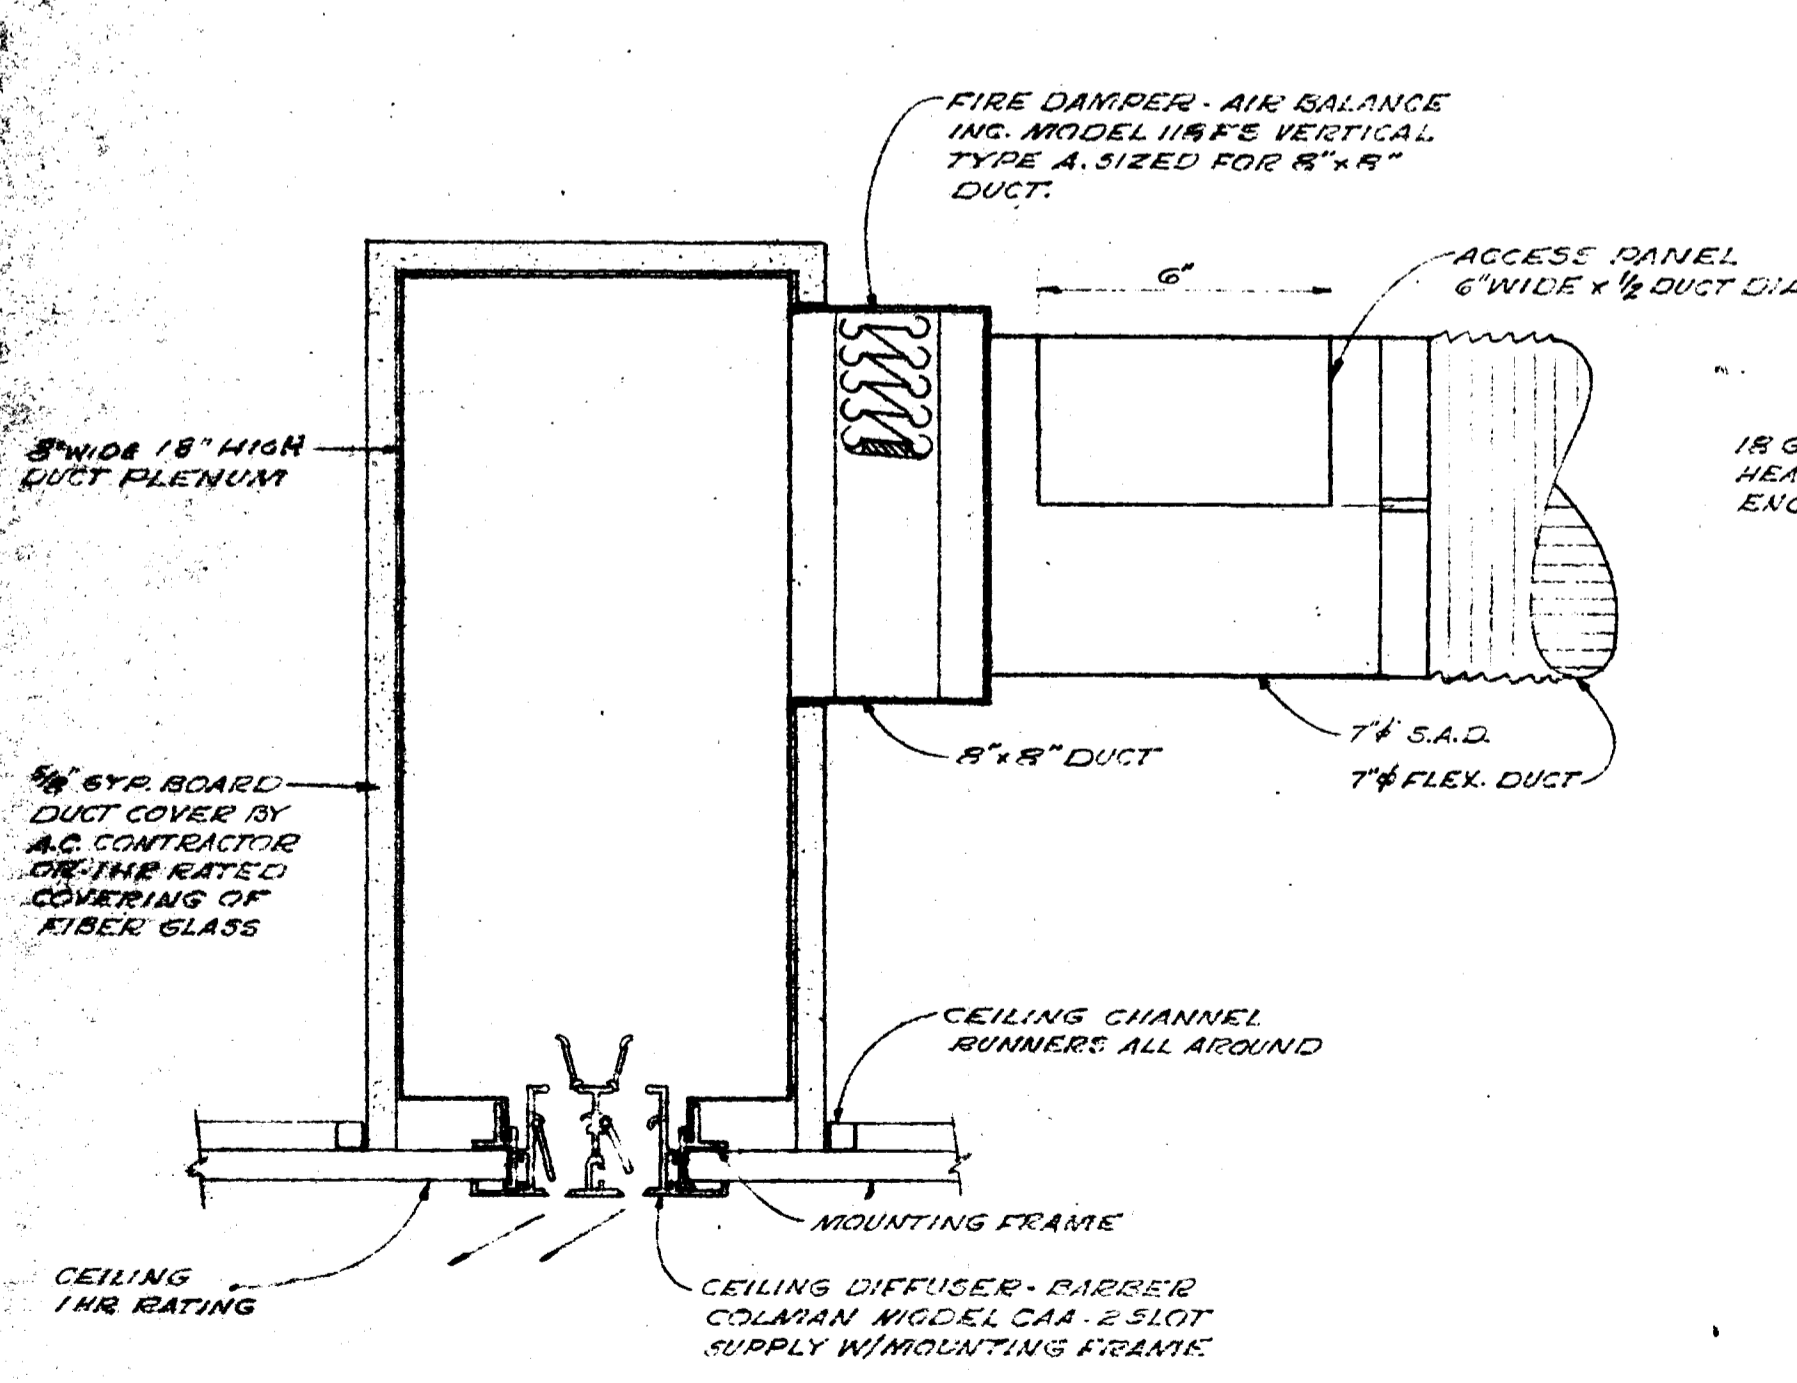

3 CEILING LINEAR DIFFUSER MOUNTING DETAIL
SCALE: 5/8" = 1'-0"

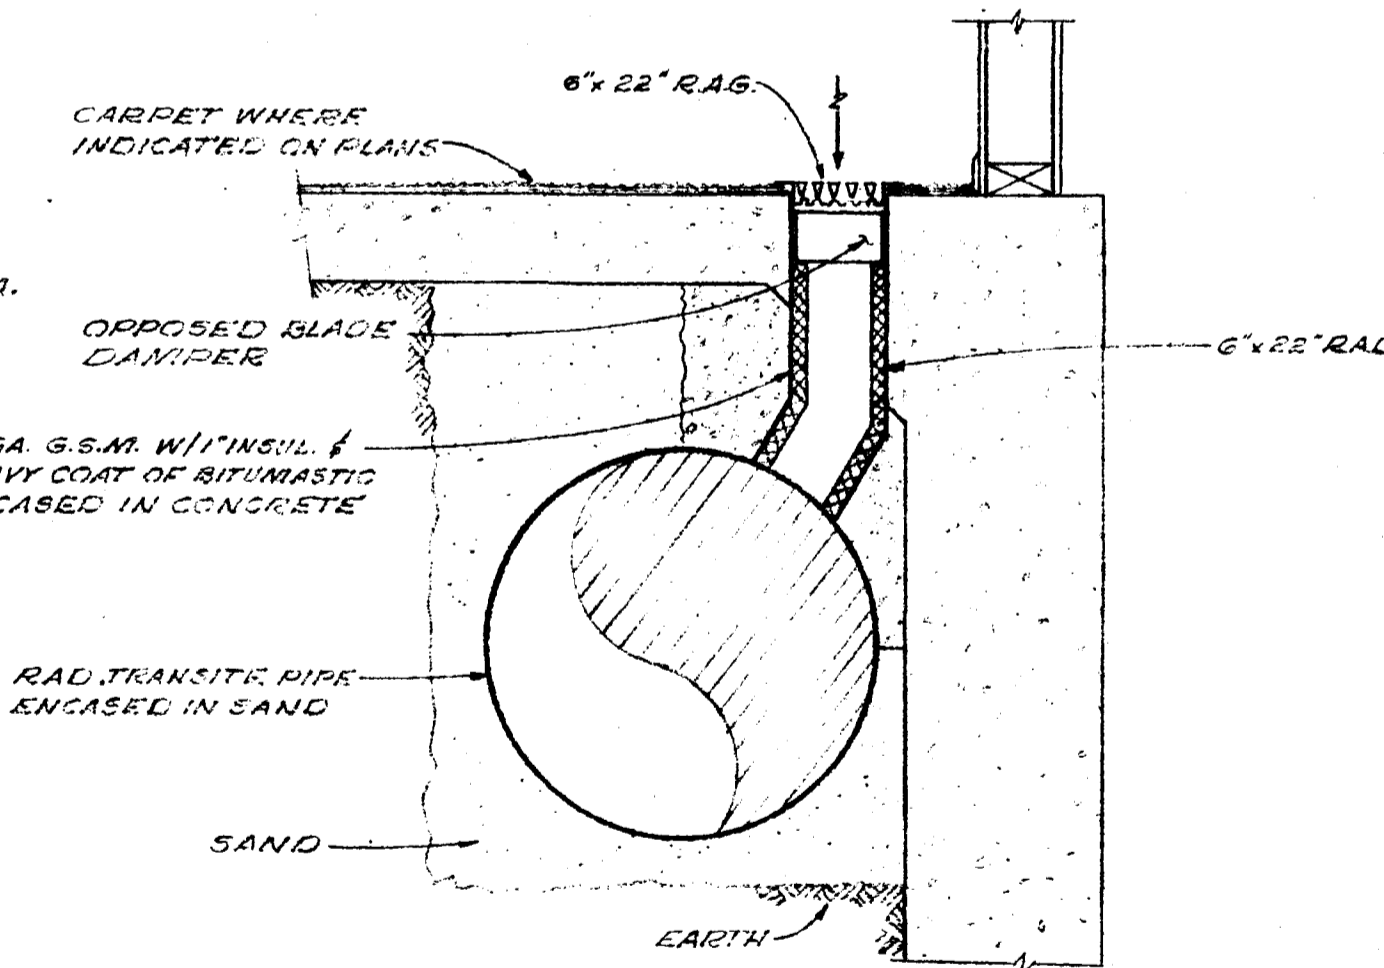


4 SECTION
SCALE: 1/2" = 1'-0"

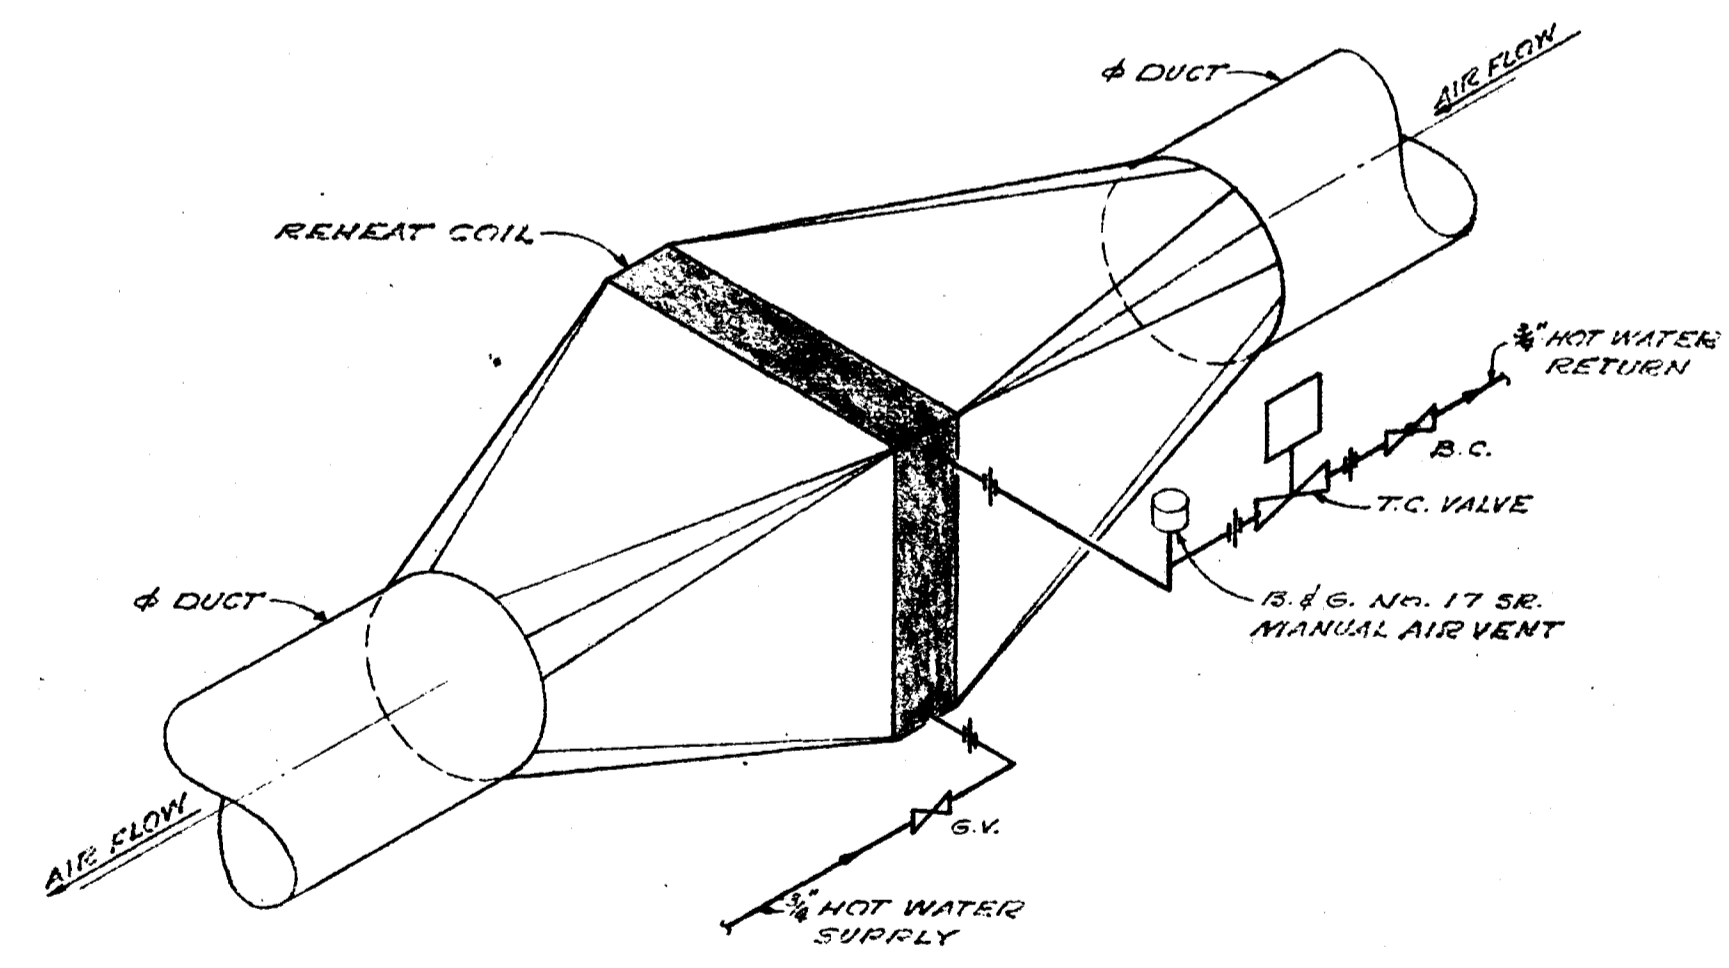

TYPICAL REHEAT COIL PIPING DETAIL
NO SCALE

REGISTER, GRILLE & DIFFUSER SCHEDULE

MARK	SIZE	TYPE	MFR	REMARKS
1	36x2	C44	BARBER COLMAN	DIFFUSER
2	22x6	TSA	"	REGISTER
3	36x4	C44	"	DIFFUSER
4	30x4	GFAVD	"	REGISTER
5	52x4	GFAVD	"	"
6	6x2	SF3V	"	DIFFUSER
7	24x10	PES	"	GRILLE
8	18x18	GMB	"	"
9	10x10	PES	"	REGISTER
10	12x10	PES	"	"
11	16x5	GMEV	"	"
12	14x22.5	GJ	"	"
13	36x8	C44	"	GRILLE

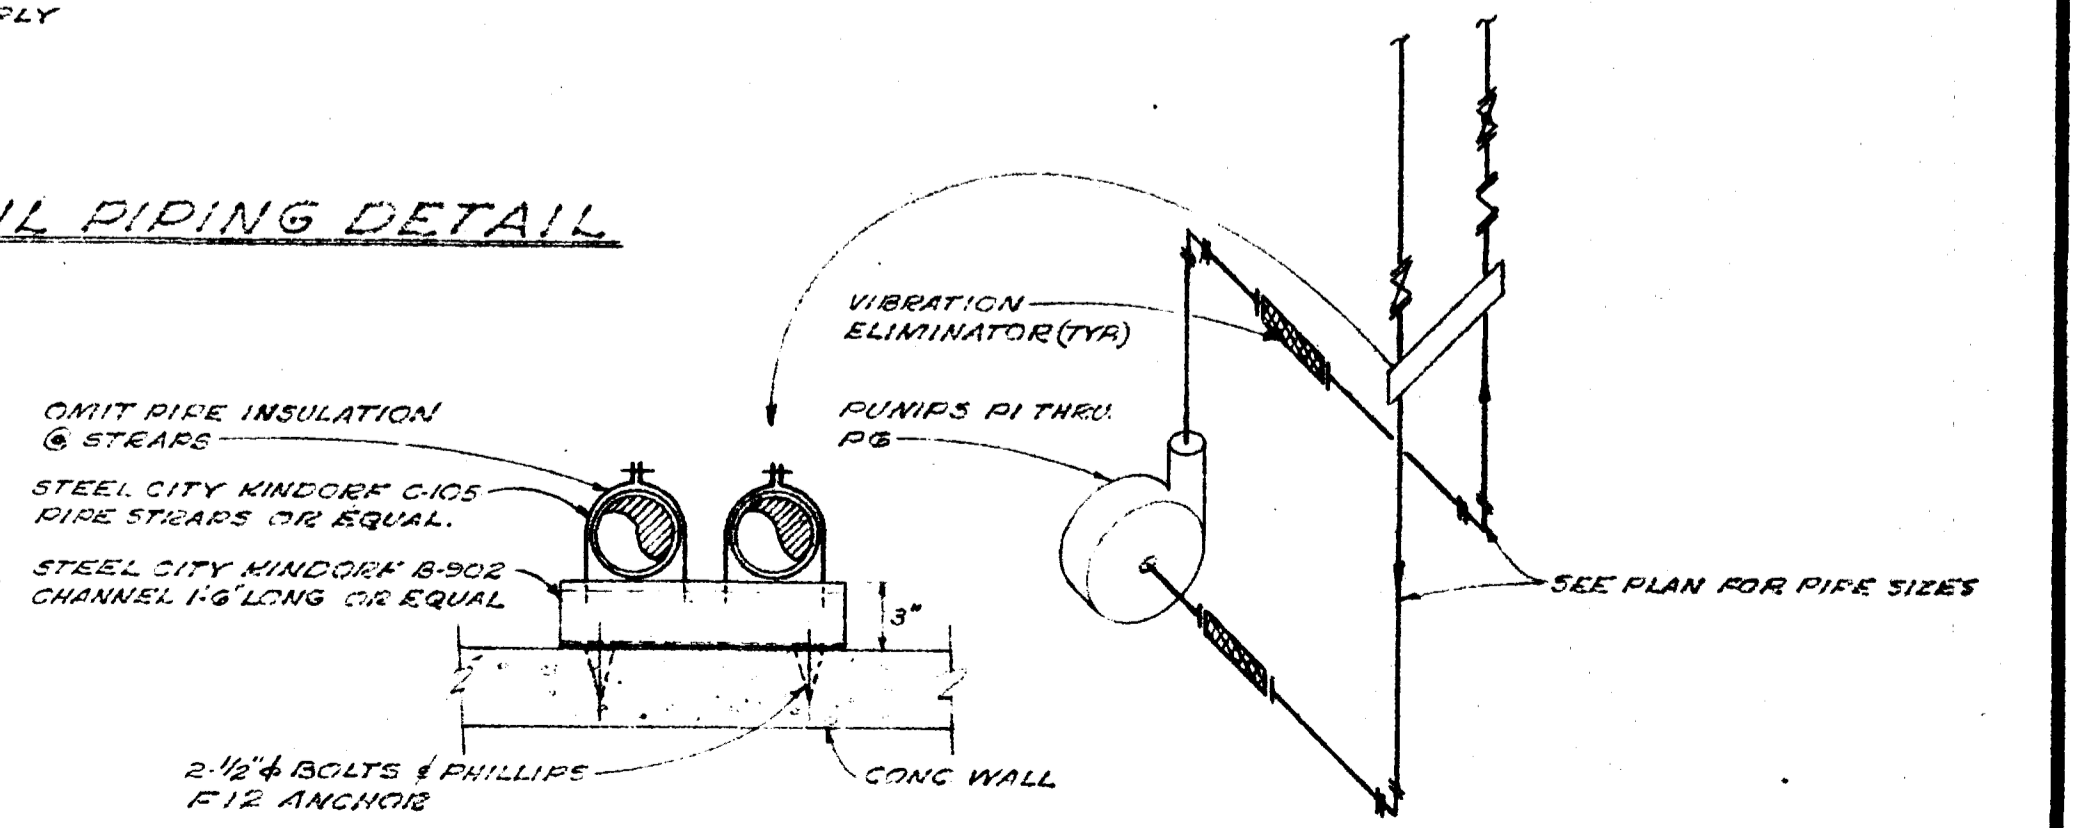

5 PUMP PIPING SUPPORT DETAIL
NO SCALE

WILFRED E. BLESSING A.I.A. ARCHITECT & LANDSCAPE ARCHITECT
 1001 THE ALAMEDA SAN JOSE, CALIFORNIA 95126
 AIR CONDITIONING DETAILS, SCHEDULES, CONTROLS AND SECTIONS
 DRAWN BY: [Signature]
 CHECKED BY: [Signature]
 DATE: 12/22/68